

TFI-Report 23-000747-01

Impact Sound Insulation

Customer	SuZhou Tuntex Fiber & Carpet Co. Ltd. No. 28 Cheng Xi South Road TaiCang JiangSu CN
Product	Tuntex 840gm pile weight nylon carpet tile with LuxCushion

This report includes 9 pages.



Aachen, 07.07.2023

Dr. Andreas Zoëga
Head of Testing Laboratory




The present document is provided with an advanced electronic signature.

This report only applies to the tested samples and has been established to the best of our knowledge. Only the entire report shall be reproduced. Under no circumstances, extracts shall be used. Furthermore, we apply the "General Terms and Conditions for the Execution of Contracts" of the TFI Aachen GmbH, also with regard to the order execution.

The test result does not include any addition or deduction for uncertainties due to measurement, sample preparation, sample collection and production tolerances.



Notified Body
No. 1656



Testing laboratory,
inspection and certification
body recognised by the DIBT
(Deutsches Institut für Bautechnik)



Accredited for the methods indicated in
the partial reports to the DAkkS certificate

TFI Aachen GmbH
Charlottenburger Allee 41
52068 Aachen/Germany
www.tfi-aachen.de

HRB 8157 Aachen
UST-IdNr. DE209411312
Managing Director
Dr. Jacqueline Lemm

1 Transaction

Order date	23.06.2023
Order number	23-000747 - AB2300563
Your reference	Kurt Wu
Product designation	Tuntex 840gm pile weight nylon carpet tile with LuxCushion

TFI sample number 2301065

Date of sample receipt 28.06.2023

Test order:

Impact sound insulation according to EN ISO 10140 ^a

a ... Die mit a gekennzeichnete Prüfung basiert auf nach EN ISO/IEC 17025 akkreditierten Prüfungen./The test marked a are based on tests accredited in accordance with EN ISO/IEC 17025.

Responsible at TFI:




Florian Guttenbacher
+49 241 9679171
f.guttenbacher@tfi-aachen.de

2 Product description

TFI sample number

2301065

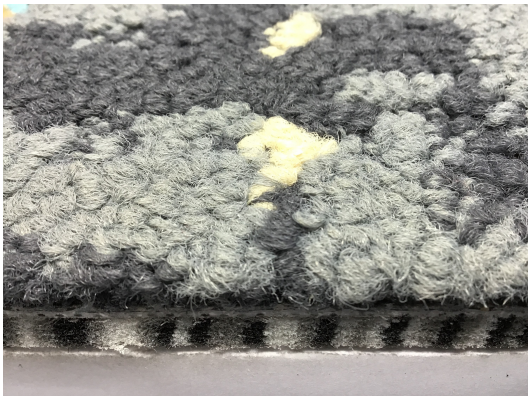

Total thickness in mm * 14,00
Total mass per unit area in g/m² * 3850

*Angabe des Auftraggebers/Customer Information

3 Results

Impact sound insulation $\Delta L_w = 37$ dB

The measurement results are evaluated without consideration of the measurement uncertainty with reference to compliance with limit values, unless otherwise specified by the test standard.

4 Partial Reports

Impact sound insulation according to EN ISO 10140

Partial Report – Impact sound insulation according to EN ISO 10140-3


Laboratory measurements of the reduction of transmitted impact noise by floor coverings on a heavyweight reference floor

TFI sample number:	2301065	Testing period:	05.07.2023
Installed by:	TFI Aachen GmbH	Installation:	05.07.2023
Size of test area:	1 m ²		
Category:	I		
Connection with the floor:	loosely laid		
Construction:	-		

(if multi-parted;
from top to bottom)

Frequency f [Hz]	L _{n,0} 1/3 oct. [dB]	ΔL 1/3 oct. [dB]
50	52,3	4,1
63	57,2	4,7
80	58,3	8,8
100	60,5	11,5
125	64,0	14,3
160	70,7	20,3
200	68,7	23,0
250	70,3	27,4
315	67,7	32,8
400	69,7	32,6
500	71,2	38,0
630	69,9	43,1
800	70,8	51,2 ¹
1000	71,0	55,5
1250	71,7	56,5 ¹
1600	72,3	62,9 ¹
2000	72,1	63,4
2500	71,7	66,2 ¹
3150	71,5	68,6 ¹
4000	70,5	68,0 ¹
5000	68,4	65,5 ¹

¹ Zu hoch / too high

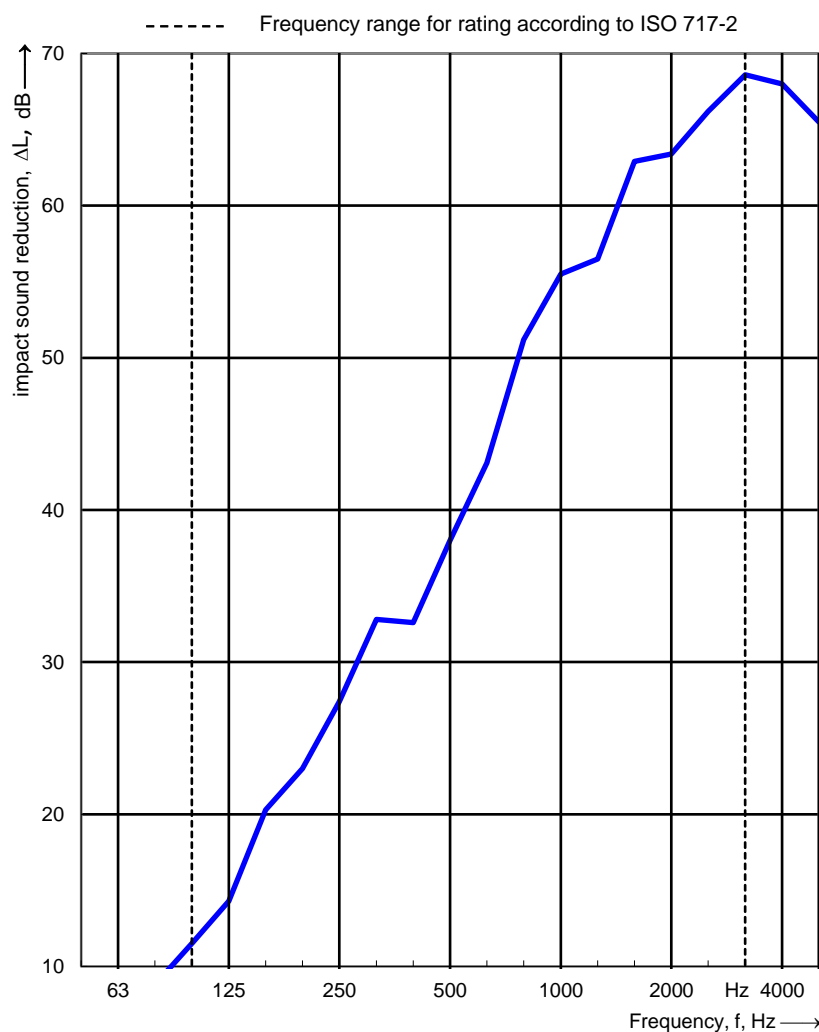

Evaluation according to ISO 717-2

$\Delta L_w = 37$ dB

$\Delta L_{in} = 24$ dB

$C_{i,\Delta} = -13$ dB

$C_{i,r} = 2$ dB

The results are based on measurements, which were performed under laboratory conditions with artificial excitation (standard procedure).

Measurements in one-third octaves.

Impact sound insulation according to EN ISO 10140-3

Laboratory measurements of the reduction of transmitted impact noise by floor coverings on a heavyweight reference floor

Evaluation according to ISO 717-2

$$\Delta L_w = 37 \text{ dB}$$

$$C_{i,\Delta} = -13 \text{ dB}$$

$$C_{i,r} = 2 \text{ dB}$$

The results are based on measurements, which were performed under laboratory conditions with artificial excitation (standard procedure). Measurements in one-third octaves.

Weighted normalized impact sound pressure level

$$L_{n,0,w} = 78 \text{ dB}$$

Weighted normalized impact sound pressure level

$$L_{n,w} = 40 \text{ dB}$$

Frequency [Hz]	ΔL [dB]	$L_{n,0}$ [dB]	L_n [dB]
50	4,1	52,3	48,2
63	4,7	57,2	52,5
80	8,8	58,3	49,5
100	11,5	60,5	49,0
125	14,3	64,0	49,7
160	20,3	70,7	50,4
200	23,0	68,7	45,7
250	27,4	70,3	42,9
315	32,8	67,7	34,9
400	32,6	69,7	37,1
500	38,0	71,2	33,2
630	43,1	69,9	26,8
800	51,2	70,8	19,6
1000	55,5	71,0	15,5
1250	56,5	71,7	15,2
1600	62,9	72,3	9,4
2000	63,4	72,1	8,7
2500	66,2	71,7	5,5
3150	68,6	71,5	2,9
4000	68,0	70,5	2,5
5000	65,5	68,4	2,9

Receiving room:

Volume: 62,5 m³

Air temperature: 22,2 °C

Relative air humidity: 45,7 %

Air pressure: 99,1 kPa

Sending room:

Volume: 51,4 m³

Air temperature: 22,6 °C

Relative air humidity: 46,0 %

Type of reference floor: Heavyweight

Remarks:

-

TFI sample number: 2301065

Rev 2

Procedure description – Impact sound insulation according to EN ISO 10140


1 Test method / Requirements

EN ISO 10140-1:2021	Acoustics - Laboratory measurement of sound insulation of building elements - Part 1: Application rules for specific products
EN ISO 10140-3:2021	Acoustics - Laboratory measurement of sound insulation of building elements - Part 3: Measurement of impact sound insulation
EN ISO 10140-4:2021	Acoustics - Laboratory measurement of sound insulation of building elements - Part 4: Measurement procedures and requirements
EN ISO 10140-5:2021	Acoustics - Laboratory measurement of sound insulation of building elements - Part 5: Requirements for test facilities and equipment
EN ISO 717-2:2020	Acoustics - Rating of sound insulation in buildings and of building elements - Part 2: Impact sound insulation
ISO 12999-1:2020	Acoustics - Determination and application of measurement uncertainties in building acoustics - Part 1: Sound insulation


2 Laboratories

Test rooms:	TFI Aachen GmbH, Charlottenburger Allee 41, 52068 Aachen
Sending room (BAL1):	Room volume $V = 5,96 \text{ m} \times 3,85 \text{ m} \times 2,24 \text{ m} = 51,40 \text{ m}^3$ (cuboid room with absorbent cladding)
Receiving room (BAL2):	Room volume $V = 6,11 \text{ m} \times 4,01 \text{ m} \times 2,55 \text{ m} = 62,48 \text{ m}^3$ (cuboid room)
Reference floor:	$S = 5,96 \text{ m} \times 3,85 \text{ m} = 22,95 \text{ m}^2$ 16 cm concrete slab floor with an area-related mass of $m' \approx 384 \text{ kg/m}^2$ Elastically mounted to suppress flank transmission.
Flanking walls:	Walls in the sending room with acoustic facing shell to suppress flank transmission.

Profile:

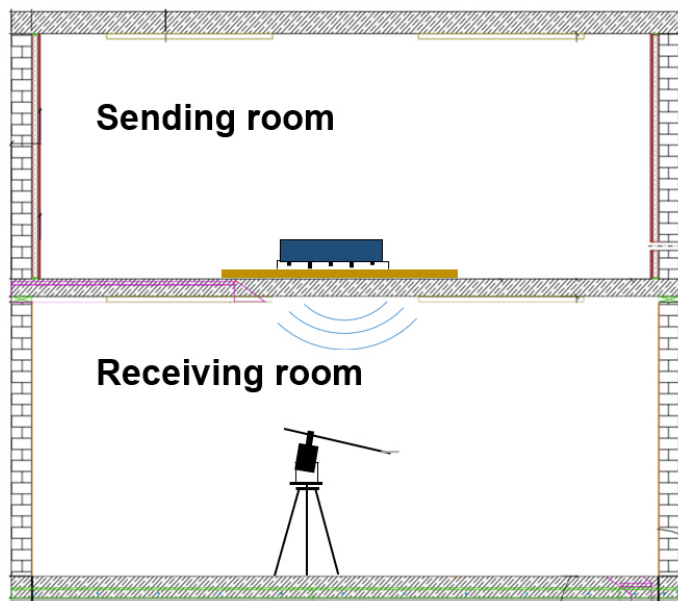

Plan view receiving room:

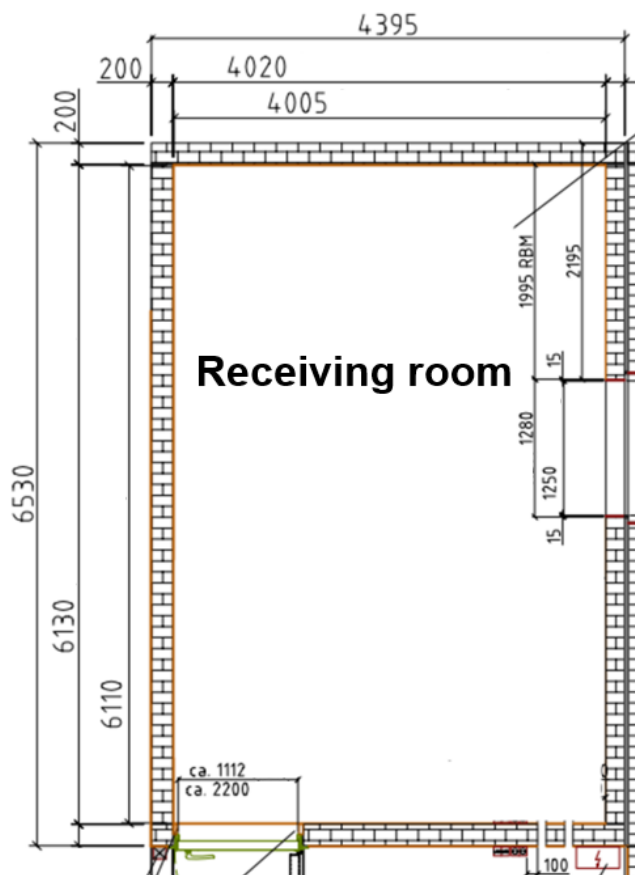

3 Measuring devices

Real-time analyzer:	1 Norsonic Nor140
Microphone:	2 Norsonic Type1209
Loudspeaker:	1 Norsonic Nor229
Tapping machine:	1 Norsonic Nor277 (standard tapping machine with 3 feet and 5 hammers according to ISO 10140)

4 Measuring operation

Impact sound pressure level: 4 microphone positions with 2 tapping machine positions each

5 Evaluation

The impact sound pressure level generated by the standard tapping machine is measured in the receiving room under a bare heavy floor with and without a floor covering. The impact sound reduction is determined on the basis of the measured values as follows:

$$\Delta L = L_{n,0} - L_n \text{ [dB]}$$

$L_{n,0}$ Impact sound pressure level without a floor covering [dB]

L_n Impact sound pressure level with a floor covering [dB]

For the evaluation of the weighted reduction in impact sound pressure level ΔL_w , the relevant reference curve is shifted in increments of 1 dB towards the measured curve until the sum of unfavourable deviations is as large as possible, but not more than 32 dB.

The linear impact sound level ΔL_{lin} is determined according to the following equation:

$$\Delta L_{lin} = L_{n,r,0,w} + C_{l,r,0} - (L_{n,r,w} + C_{l,r}) = \Delta L_w + C_{l,\Delta}$$

$L_{n,r,w}$ the calculated weighted normalized impact sound pressure level of the reference floor with the floor covering under test

$L_{n,r,0,w}$ 78 dB, calculated from $L_{n,r,0}$ according to section 4.3.1 of EN ISO 717-2

$C_{l,r}$ Spectrum adaptation term for the reference floor with the floor covering to be tested

$C_{l,r,0}$ -11 dB, spectrum adaptation term for the reference floor with $L_{n,r,0}$ determined according to A.2.1 EN ISO 717-2

6 Note

The results are based on measurements performed under laboratory conditions with artificial excitation (standard procedure). The test results are applicable in due consideration of the national provisions and the local circumstances and/or constructions.